



Service openings for green area

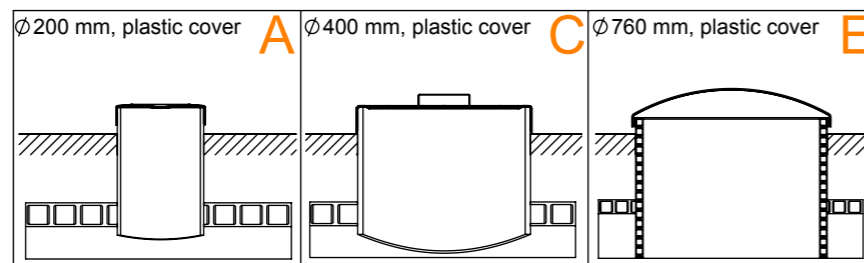

Service openings for asphalt area

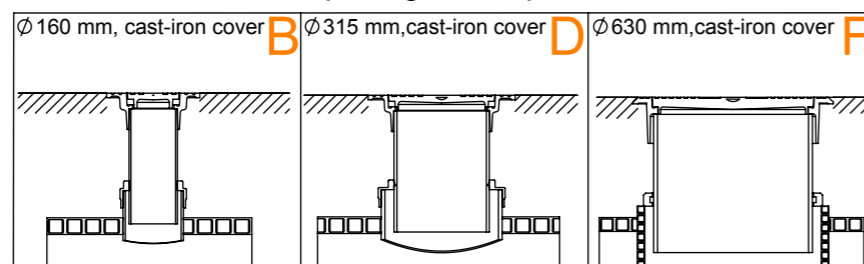

Service opening height :
 Type of service opening:
 Service opening distance:
 Inlet pipe diameter:
 Alarm device:

standard height 950 mm or h=..... mm
 A B C D E F
 standard in the center or L1=..... mm
 d1=..... mm
 Yes No

| No | Name | Material | Dimensions |
|----|--------------------------------|----------|------------|
| 1 | Storage tank, double-wall pipe | PE | ∅ 1110 |
| 2 | Inlet pipe | PE | d1 |
| 3 | Service opening | PE | |
| 4 | Alarm device Tank-Check RF-412 | | |

| | | | | | |
|----------------------------------|--|--------------------|----------|------------------------------|---------------|
| Metric: mm | Material: Unspec. | Finish: Unspec. | Mass: kg | Size: A3 | Sheet: 1/1 |
| Drawn: L.Roomet | STRONG Storage tank ∅ 1000, 8000L | | | | |
| Approved: M.Somelar | | | | | |
| EcoTank www.ecotank.fi | | | | Drawing number: NA | |